


PHASE 1 PHASE 2

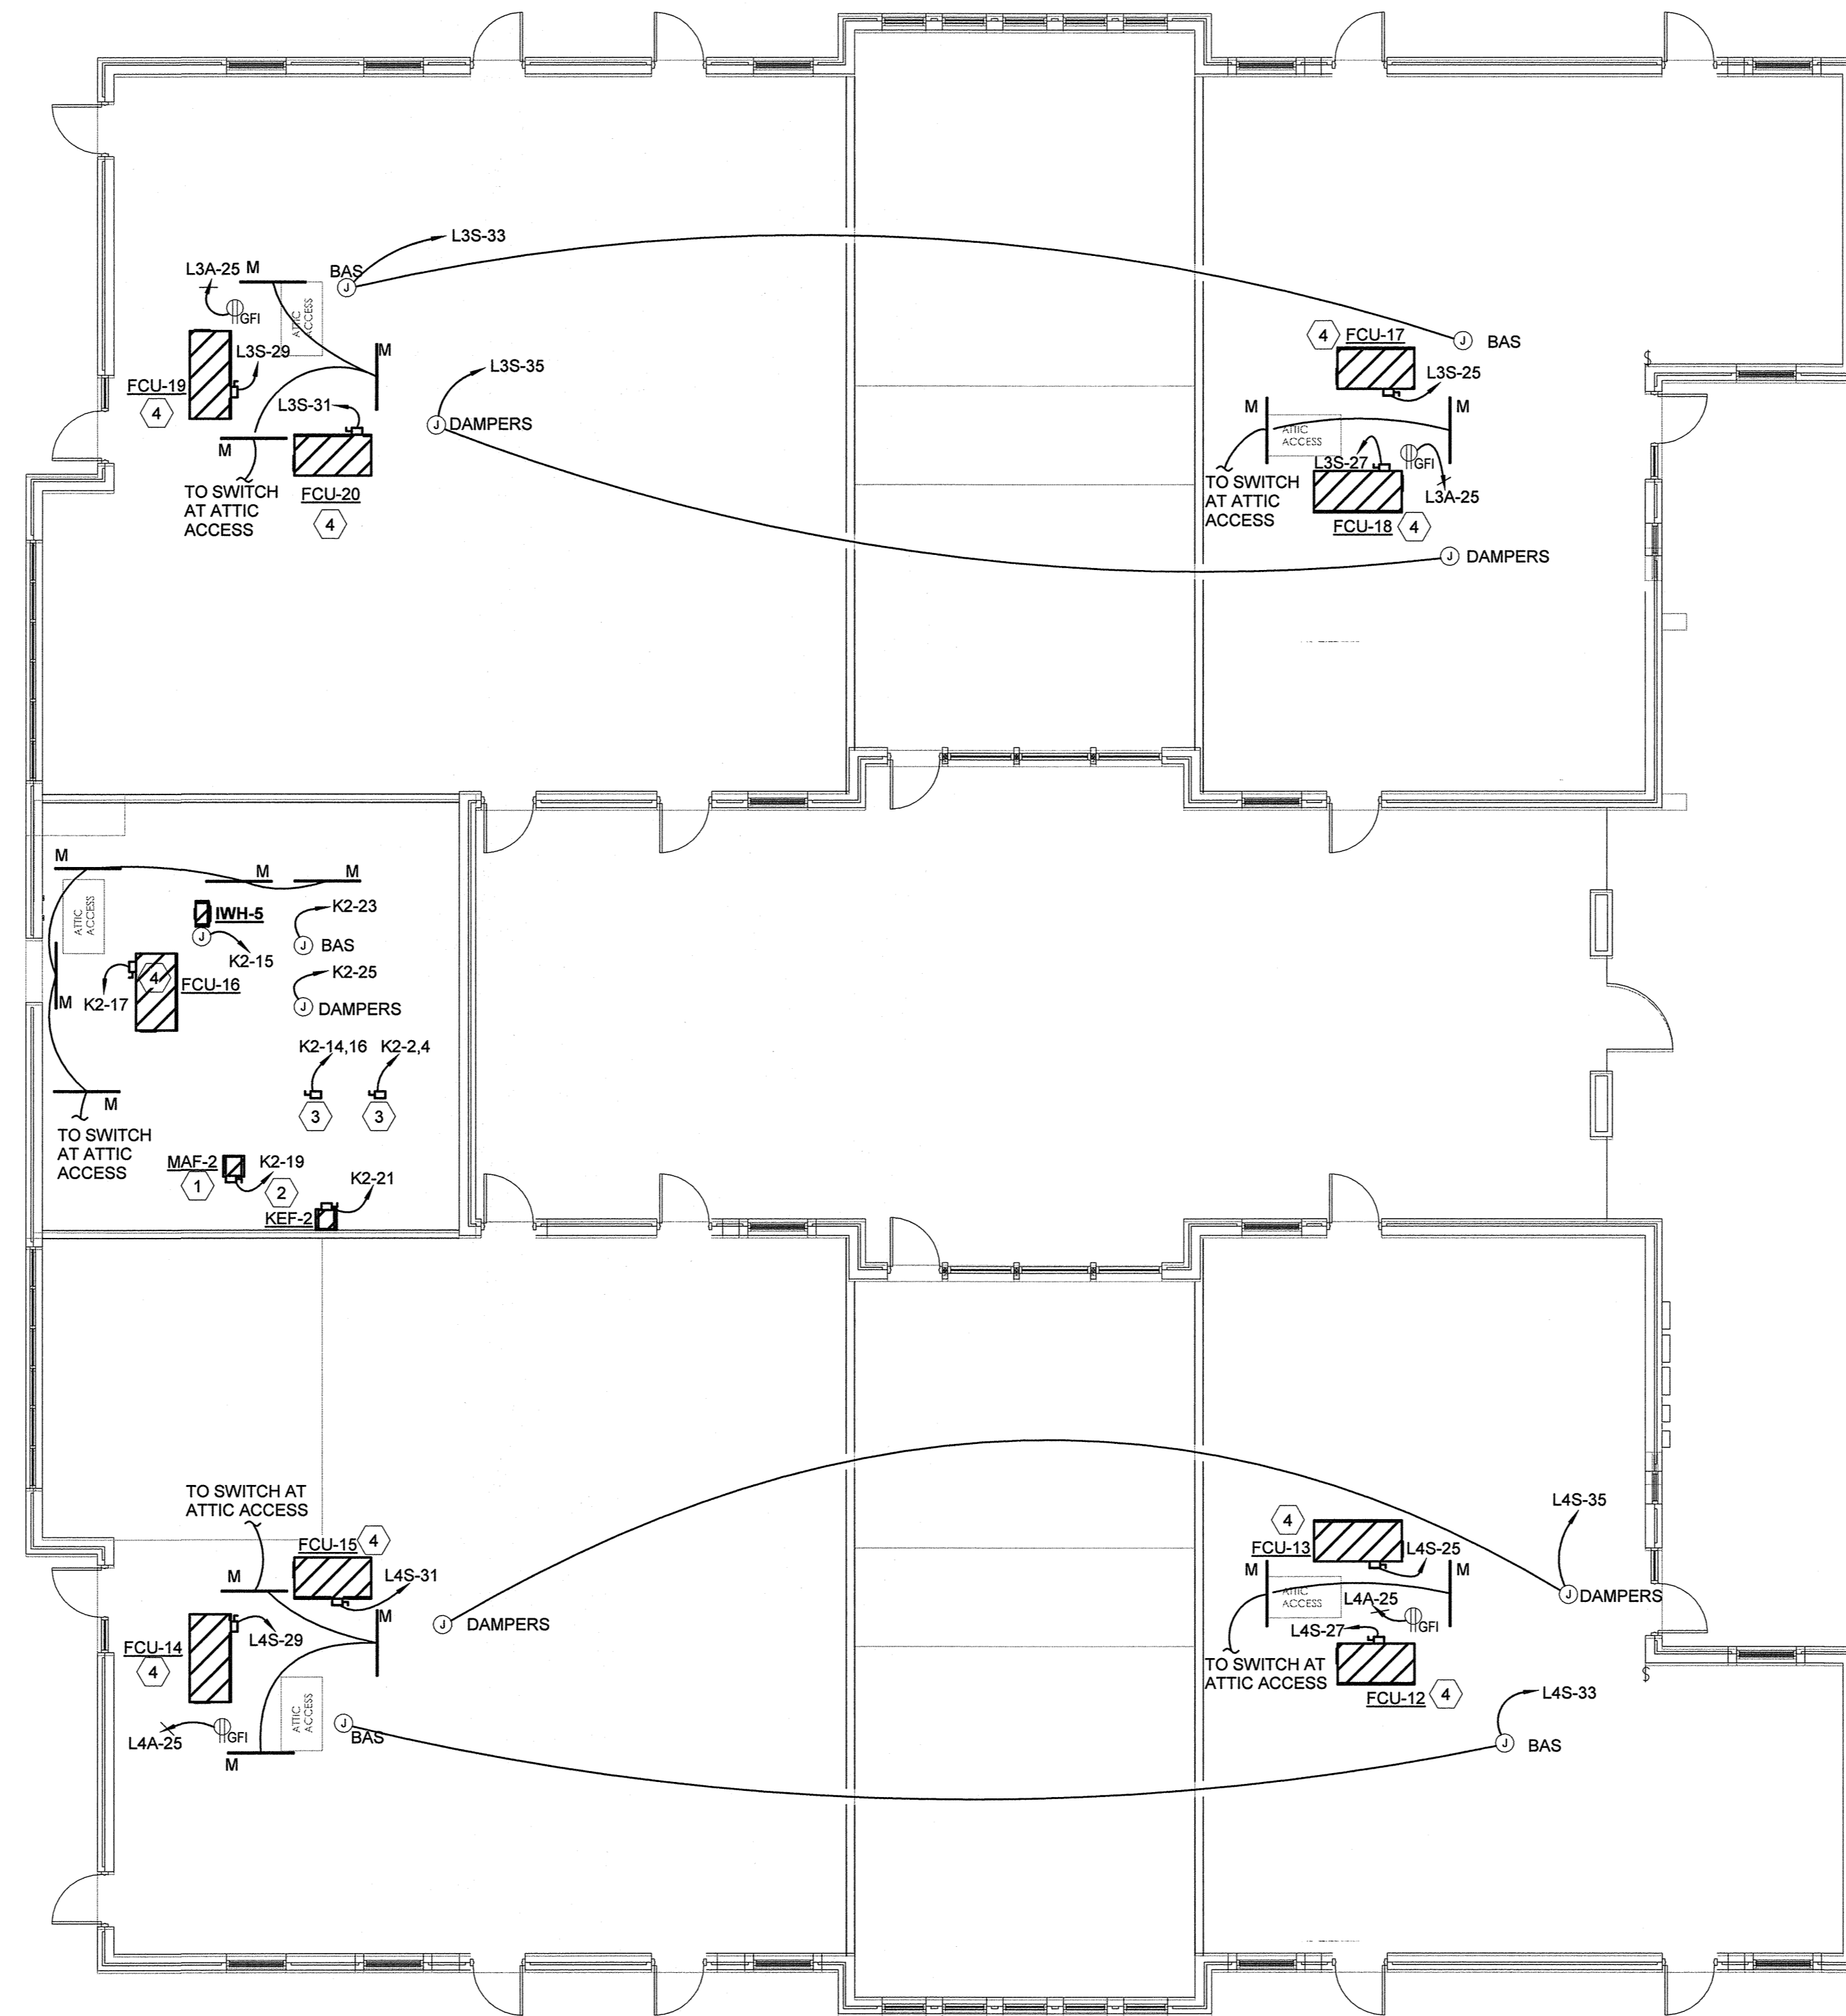


- KEYED NOTES**
- 1 PROVIDE CONNECTION TO MAKE UP AIR FAN (MAF-2). VERIFY WITH MECHANICAL CONTRACTOR IF DISCONNECT IS PROVIDED, IF NOT REFER TO PANEL SCHEDULE FOR DISCONNECT SIZE.
 - 2 PROVIDE CONNECTION TO KITCHEN EXHAUST FAN (KEF-2). VERIFY WITH MECHANICAL CONTRACTOR IF DISCONNECT IS PROVIDED, IF NOT REFER TO PANEL SCHEDULE FOR DISCONNECT SIZE.
 - 3 ELECTRICAL CONTRACTOR SHALL COORDINATE AND PROVIDE CONNECTION TO WALK-IN COOLER/FREEZER CONDENSING EQUIPMENT.
 - 4 PROVIDE CONNECTION TO FAN COIL UNIT. VERIFY WITH MECHANICAL CONTRACTOR IF DISCONNECT IS PROVIDED, IF NOT REFER TO PANEL SCHEDULE FOR DISCONNECT SIZE.

REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL PHASING INFORMATION.

1 ELECTRICAL POWER AND LIGHTING PLAN - AREA B - MEZZANINE LEVEL
 1/8" = 1'-0"




File Name: C:\DWG\Revit\Projects\7915213.00-Electrical\R15_saad.mahmoud.rvt
 User: saad
 Date/Time: 9/9/2015 3:50:20 PM

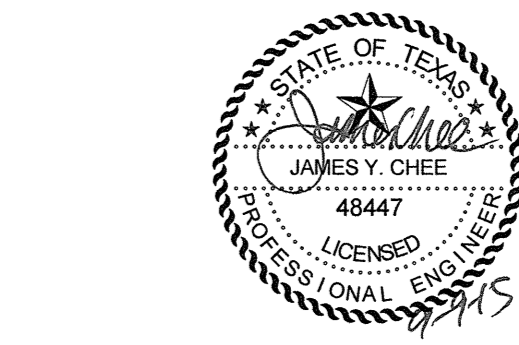

KCI
 ENGINEERS
 PLANNERS
 SCIENTISTS
 CONSTRUCTION MANAGERS
 801 TRAVIS, SUITE 2000
 HOUSTON, TX 77002
 TECHNOLOGIES Ph: 713-237-9800 | Fax: 713-237-9801
 Texas Registered Engineering Firm F-10573

OPTIMUM CARE
SUGAR LAND, TEXAS

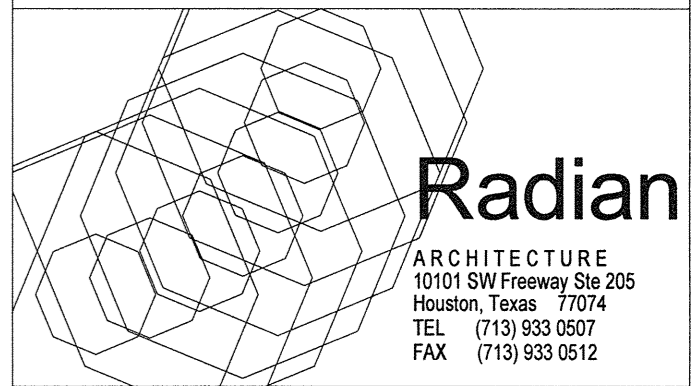

Revision Schedule

#	Date	Description
3	09-04-15	PERMIT REVISIONS

Project No.
ELECTRICAL PLAN - AREA B - MEZZ LEVEL

Sheet No.

E1.04